




# AMERICAN ONSITE CONTROLS

AMERICAN MANUFACTURING COMPANY INC.

P.O. BOX 97 ELKWOOD, VA 22718

(800) 345-3132 www.americanonsite.com

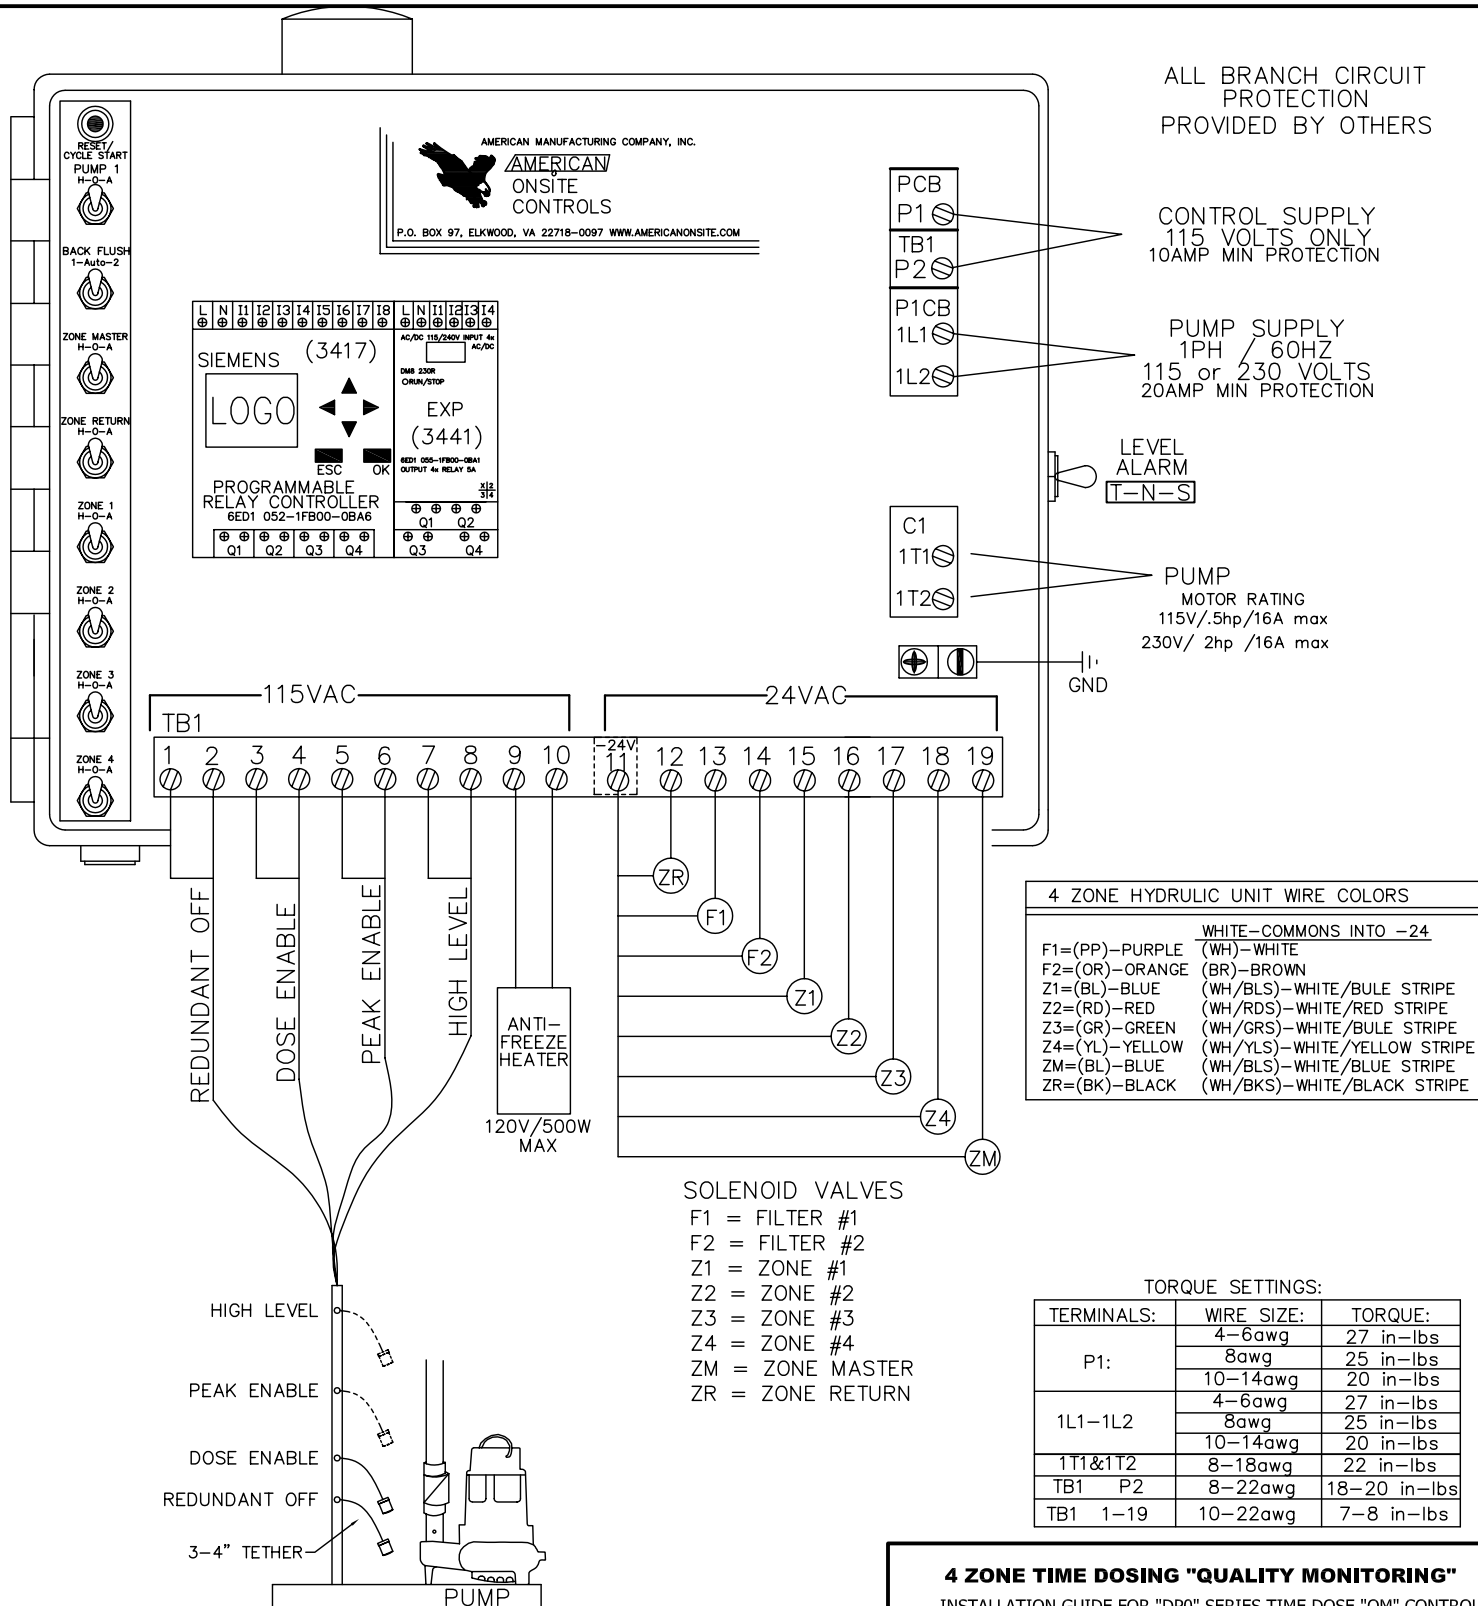

ALL BRANCH CIRCUIT PROTECTION PROVIDED BY OTHERS

CONTROL SUPPLY 115 VOLTS ONLY 10AMP MIN PROTECTION

PUMP SUPPLY 1PH / 60HZ 115 or 230 VOLTS 20AMP MIN PROTECTION

LEVEL ALARM T-N-S

PUMP MOTOR RATING 115V/.5hp/16A max 230V/ 2hp /16A max

**NOTES:**

- PLEASE REVIEW ALL PAGES AND INSERTS IN THIS MANUAL BEFORE ATTEMPTING TO INSTALL ANY CONTROL EQUIPMENT.
- DASHED LINES REPRESENT OPTIONAL EQUIPMENT
- TIME DOSING IS CONTROLLED BY A SIEMENS LOGO! SEE ADDITIONAL MANUAL FOR PROGRAMMING INSTRUCTIONS.
- BF=BACKFLUSH, AND ZR=ZONE RETURN



**4 ZONE TIME DOSING "QUALITY MONITORING"**

INSTALLATION GUIDE FOR "DP0" SERIES TIME DOSE "QM" CONTROL  
 NEMA 4X, 1 PHASE, OPTIONS: A,J,L,X(ZM)

MODEL#: DP024-SAB124-AJLX(ZM)

DWG#: X9114-4Z-ZM

REVISION -

DATE: 06/12/14

DRAWN BY: SPC

APPROVED

FILE PATH:

S:/DATA/CONTROLS/AUTOCAD2000LT/X&LIGHTNING/X9114-4Z-ZM.dwg

PAGE

1